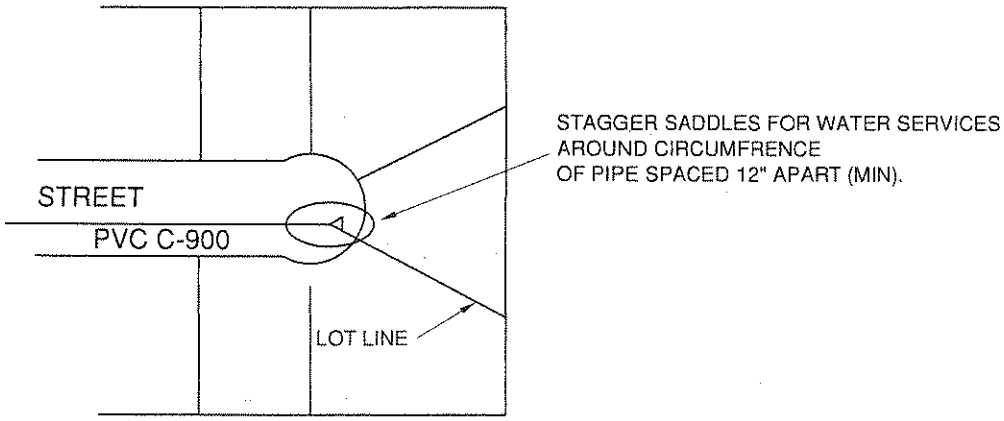

TYPICAL PLAN VIEW

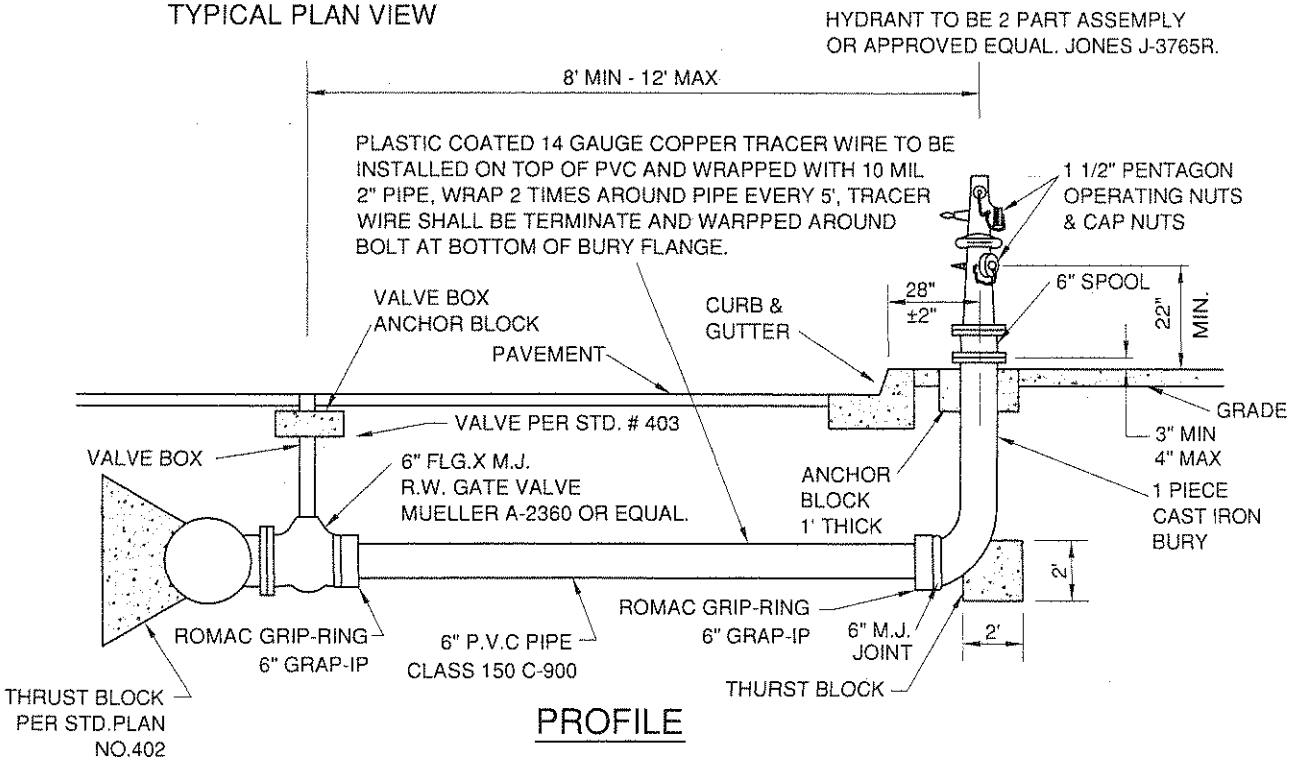

PROFILE

NOTES:

1. FIRE HYDRANT SHALL BE PLACED AT PROPERTY LINE / OR AS APPROVED BY THE CITY ENGINEER.
2. FIRE HYDRANT VALVE SHALL BE PER STD #404.
3. NO SERVICES SHALL BE TAPPED OFF OF HYDRANT RUN.

APPROVED:

P.W. DIRECTOR / CITY ENGINEER

REVISED DATE: 5/15/08

City of Westminster

DEPARTMENT OF PUBLIC WORKS

END OF LINE CONNECTIONS

STANDARD NUMBER

407